





Instruction Manual For Electric Actuator



CONTENTS

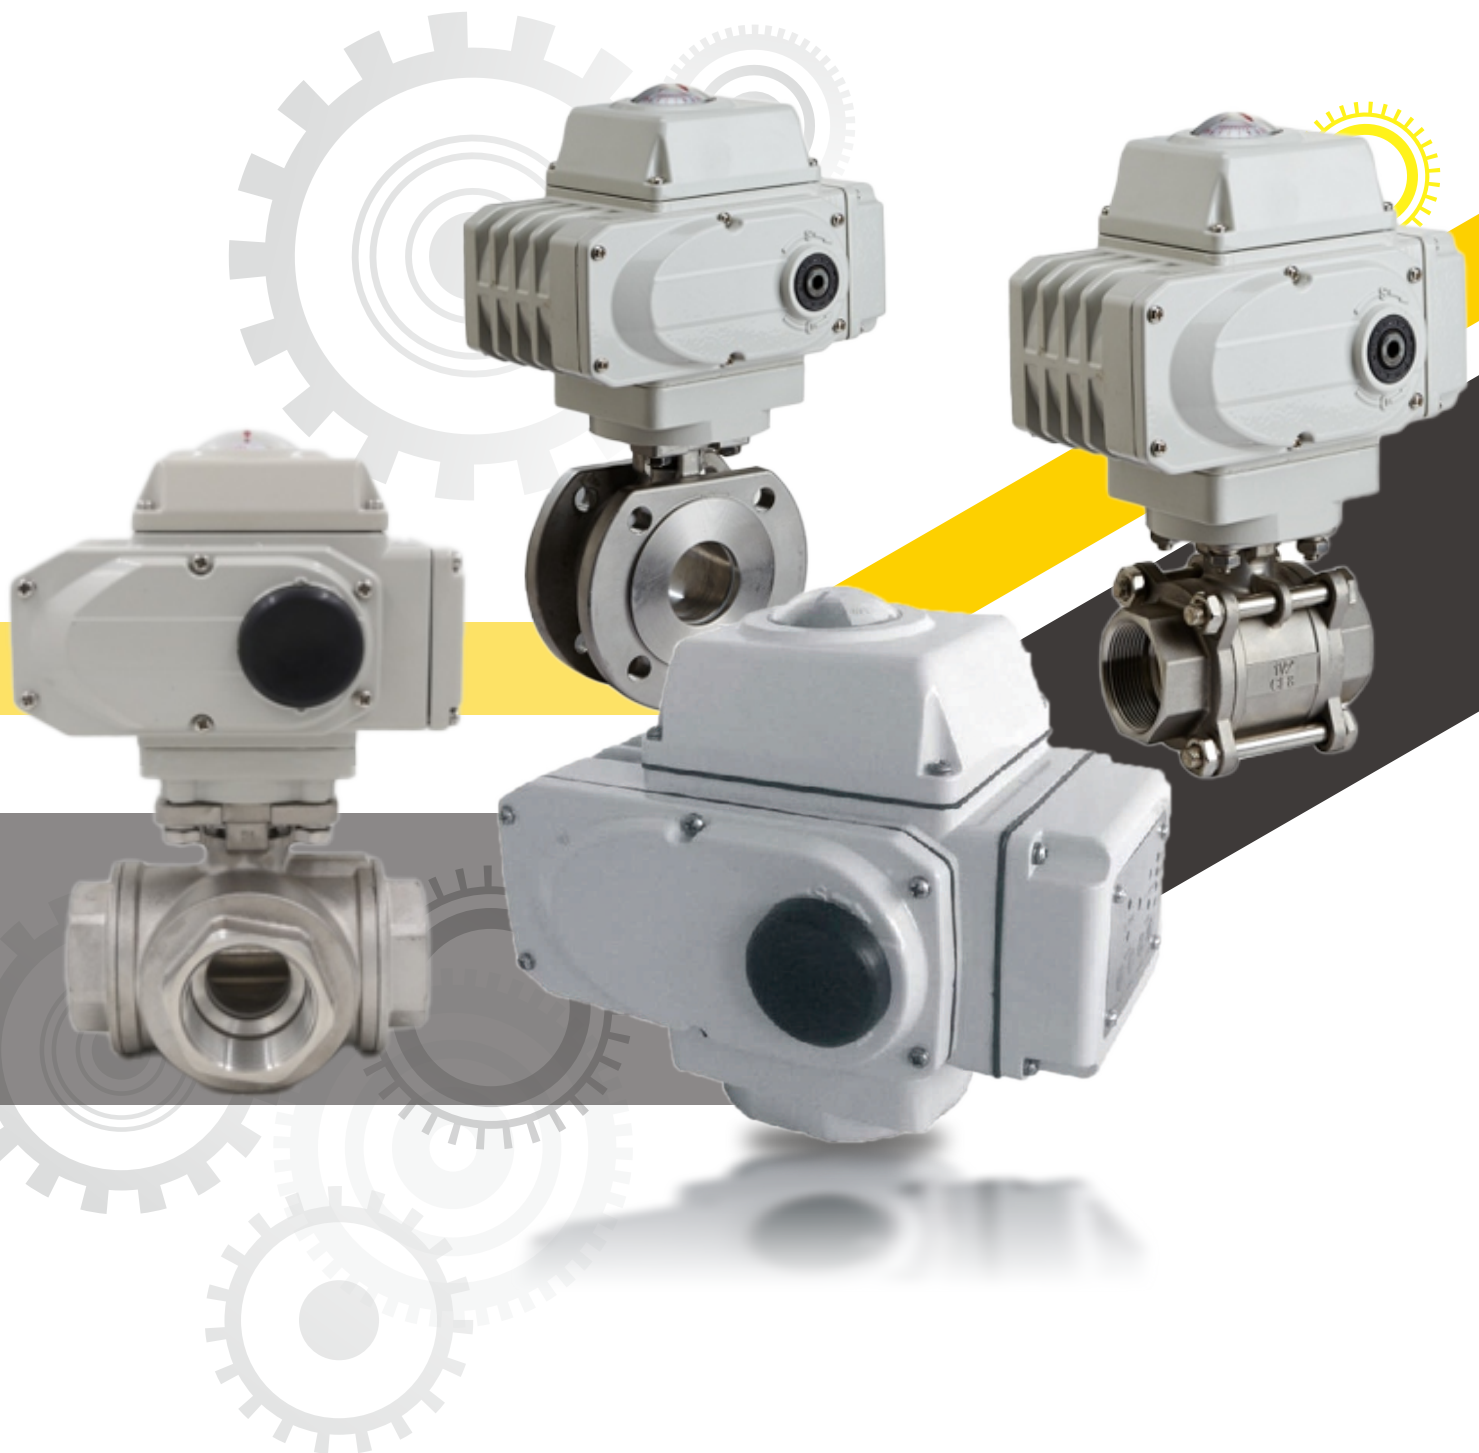

	01 Product Introduction
Overall Dimension 02	
	07 Performance Parameter of Modulating Type
Wiring Diagram 08	
	11 Power, Voltage and Installation
Adjustment of On-Off Type 12	
	14 Adjustment of Modulating Type
Model Selection 19	
	22 Failure and Countermeasure
QT Quarter-turn Valve Electric Actuators 23	


Product Introduction

The Electric Actuator is distinguished by its special design, beautiful appearance, great performance and long-time operation. The rotary valve electric actuator will win customers' hearts by its supreme performance.

Powerful function	Modulating, proportional, on-off, and various output signal; h.
Small Size	35% smaller than other of the same kind.
Light Weight	35% lighter than other of the same kind.
Beautiful Appearance	Die-casting aluminium alloy cover can prevent disturbance of electromagnetic.
Precision and Wear-resistance	Integration of worm wheel and output axle avoids the separation among keys and the forged brass alloy material is featured by high strength and good wear-resistance.
Safety Guarantee	Tested by AC 1500V and can withstand it; F-grade insulation motor guarantees safe operation.
Easy to Form Complete Set	110V, 220V, 380V alternate current and direct current are all available for simple connection.
Easy Application	No oil or point inspection is needed; waterproof, antirust and optional installation angle.
Protection Appliance	Double limits, over-hot protection, overload protection.
Various Motion Time	9s, 13s, 15s, 30s, 50s, 100s (Set Before Delivery).
Antirust and Anti-corrosion	Whole machine support, coupler and screws are made of stainless steel.
Intelligent Numerical Control	Intelligently control module is built in the actuator body so that there is no need to out positioner. Digit setting and adjusting, highly accuracy and self-diagnosis can be realized.

Appearance and Parts Name





1	Case Body
2	Opening Mete
3	Inlet Wire Lock
4	Rubber Cover of Handle Shaft
5	No-Bracket Installation
6	Gear Box Cover
7	Electric Cover
8	Wiring Cover
9	Handle Shaft Cover
10	Output Shaft
11	Adapter

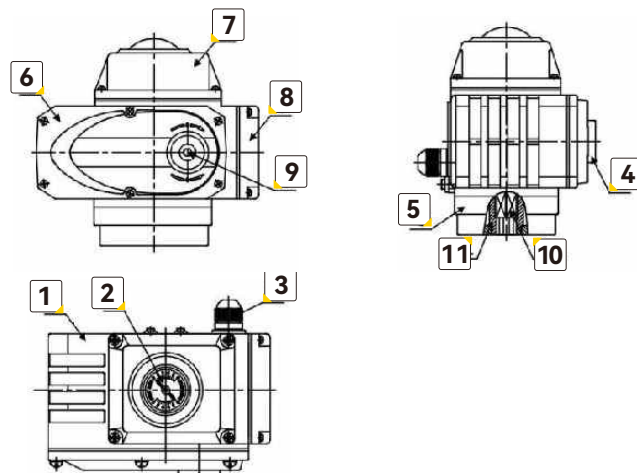

Overall Dimension





02 Performance Parameter

Model	02
Power Supply(V)	AC85-260
Output Torque(N.m.)	6
Motion Scope(°)	0-90
Motion Time(S)	7 (second)
Rated Current(A)	0.2
Drive Motor(W)	4.6
Protection Device	Motor Protection Thermistor, Mechanical Limit Block at Both Open and Close Side
Opening Detection	Position Detection Components for Full Open and Close: a. Full Open: Red(LED) b. Full Close: Green (LED)
Output Signal	Output Signals for Full Open and Close(NPN Transistor, Collector Current, Emission Stage) (Connection Capacity: DC50V, 20mA)
Application Environment	Temp: 25°C~+55°C Humidity: 10-90%RH
Output Shaft	SUS303, Φ: 12, Pit: 5, Depth: 5
Handle Shaft	Hexagon Hole Opposite Angle: 4mm (With Lid)
Waterproof	JIS C0920 Grade 6 (IP 65)
Install direction	360-Degree Optional Direction
Distribution Cable	0.3x6 Core Cable 30cm
Body Material	Die-Casting Aluminium Alloy
Colour of Coating	Gray and White
Weight(kg)	0.5

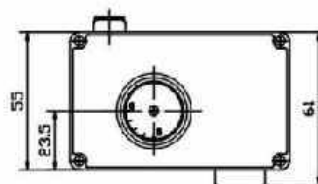





05 Performance Parameter

Model	05				
Power Supply(V)	DC24	AC24	AC110	AC220	AC380
Output Toque(Nm)	50				
Motion Times(S)	7	20			
Rotary Angle(°)	0~360				
Motor Power(W)	10	15			
Rated Current(A)	0.5	2.2	0.48	0.24	0.15
Weight(kg)	2.3	2.7			
Insulation Resistance(MΩ)	DC24V: 100/250VDC AC110/220V/380V: 100/500VDC				
Voltage Resistance Class	DC24V: 500VAC, AC110/220V: 1500VAC, AC380V: 1800VAC.(1 Min.)				
Protection Class	IP68				
Installation Position	Optional Direction: 360°				
Electrical Connection	M18×1.5 Water-proof Cable Connectors, Electric Power Wire, Signal Wire				
Ambient Temp.	-30°C~+60°C				
Circuit Control	B, S, K, R, A, D, H, T				
Optional Function	I. Over Torque Protectors II. Dehumidify Heater				

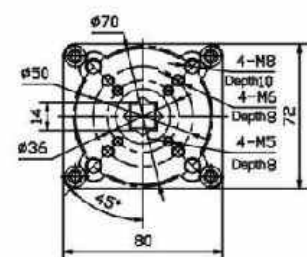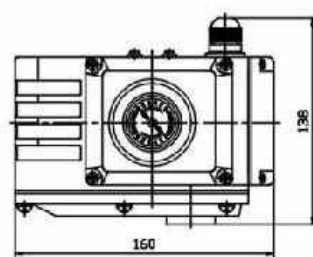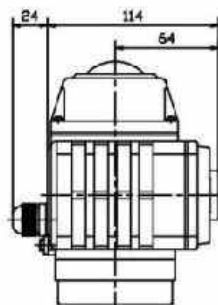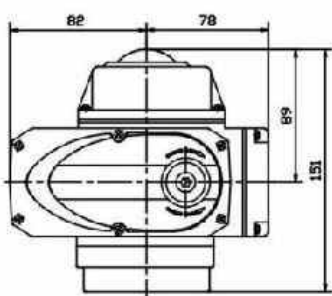


10 Performance Parameter

Model	10				
Power Supply(V)	DC24	AC24	AC110	AC220	AC380
Output Toque(Nm)	100				
Motion Times(S)	10	30			
Rotary Angle(°)	0~360				
Motor Power(W)	20	25			
Rated Current(A)	0.85	3	0.7	0.32	0.2
Weight(kg)	4	4.3			
Insulation Resistance(MΩ)	DC24V: 100/250VDC AC110/220V/380V: 100/500VDC				
Voltage Resistance	DC24V: 500VAC, AC110/220V: 1500VAC, AC380V: 1800VAC.(1 Min.)				
Protection Level	IP68				
Installation Position	Optional Direction: 360°				
Electrical Connection	M181.5 Water-proof Cable Connector, Electric Power Wire, Signal Wire				
Ambient Temp.	-30°C~+60°C				
Circuit Control	B, S, K, R, TA, D, H				
Optional Function	I. Over Torque Protectors II. Dehumidify Heater				

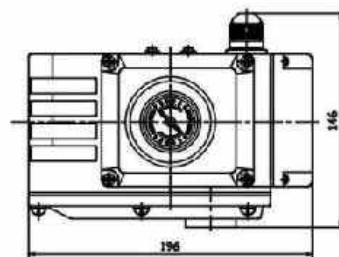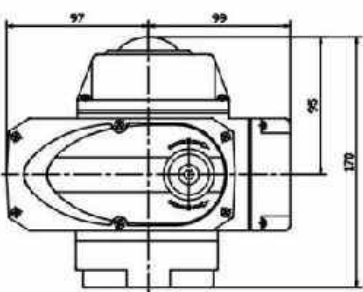

Performance Parameter of 100/200 Series

Model Power(V) Performance	100				200			
	AC24	AC110	AC220	AC380	AC24	AC110	AC220	AC380
Motor Power(W)	100				100			
Rated Current(A)	9	2.2	1.2	0.48	9	2.2	1.2	0.48
Output Toque(Nm)	800/1000				2000			
Motion Times(S)	30/50				100			
Circuit Control	B, S, K, R, A, D, H, T							
Rotary Angle(°)	0-90							
Weight(kg)	11.2				11.8			
Voltage Resistance	AC110V/AC220V: 1500VAC, AC380V: 1800VAC(Minute)							
Insulation Resistance(MΩ)	100MΩ/500VDC							
Protection Class	IP-68							
Ambient Temp.	-30°C~+60°C							
Installation Angle	Optional Direction: 360°							
Case Body Material	Die-Casting Aluminium Alloy							
Optional Function	I. Over Torque Protectors II. Dehumidify Heater							

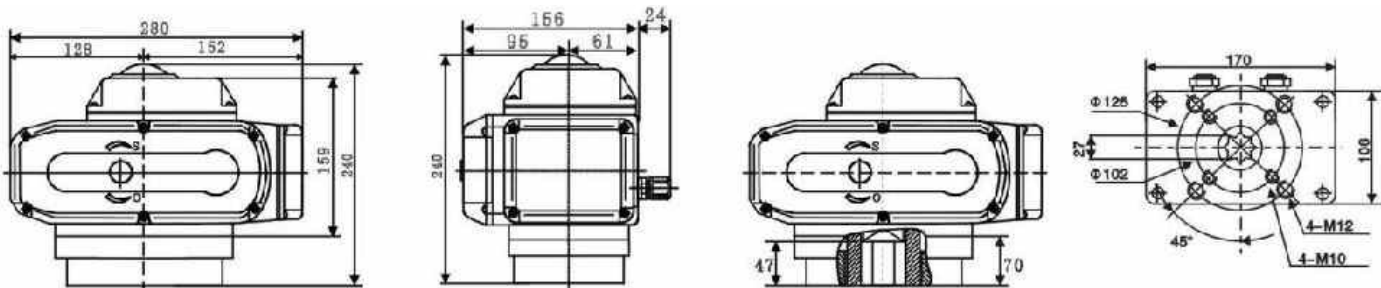


Performance Parameter of Modulating Type

Model	05A	10A	20A	40A	60A	100A	200A
Power	DC24V/AC24V, AC110V, AC220V, AC380V, 50/60HZ						
Performance	DC24V/AC24V, AC110V, AC220V, AC380V, 50/60HZ						
Motor Power(W)	15W	25W	40W	90W	90W	100W	100W
Rated Current(A)	0.24A (AC220V)	0.32A (AC220V)	0.88A (AC220V)	1A (AC220V)	1A (AC220V)	1.2A (AC220V)	1.2A (AC220V)
Output Torque(N.m.)	50Nm	100Nm	200Nm	400Nm	600Nm	1000Nm	2000Nm
Motion Time(S)	20S	30S	30S	30S	45S	50S	100S
Rotary Angle(°)	0~360°			0~90°			
Input Signal	4~20mA. DC, 1-5V.DC, 0-10V.DC(Others could be set before delivery)						
Output Signal	4~20mA.DC(Others could be set before delivery)						
Precision Grade	1%						
Weight	2.7kg	4.3kg	9.3kg	10kg	10kg	11.2kg	11.8kg
Voltage Resistance	DC24V: 500VAC/1min			1500VAC/1min			
Insulation Resistance	DC24V: 100MQ/300VDC			100MQ/500VDC			
Protection Class	IP-68						
Ambient Temp.	-30°C~+60°C						
Installation Angle	Optional Direction: 360°						
Case Body Material	Die-Casting Aluminium Alloy						
Optional Function	I. Over Torque Protectors II. Dehumidify Heater						

Wiring Diagram

Z: 02On-Off Type

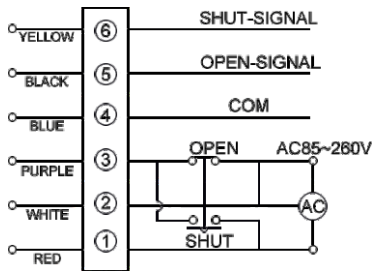


Open switch and close switch are strictly prohibited to be connected at the same time.

The actuator is equipped with dedicated cable (30cm) to distribute wiring for power and full closed full open output signal (NPN Transistor Collector Current).

Wiring Instructions:

1. Wiring distribution shall be conducted by qualified electrical engineer in accordance with electrical equipment technical standard.
2. It's prohibited to conduct wiring distribution when it's raining or the air is highly humid.
3. Make sure the wiring diagram is correctly connected.
4. Dedicated cable is built in the actuator so that internal wiring is not needed.
5. Top cover is strictly forbidden. (Cable is already available)
6. It's strictly forbidden to connect Open Switch and Close Switch simultaneously when the power is on.

B: On-Off Type (Standard)

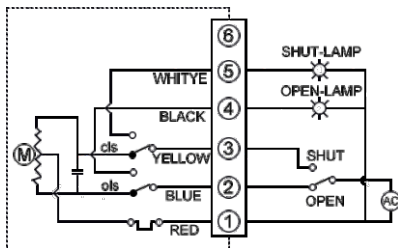


Valve can be controlled to open and close by the on-off circuit and the circuit will output a group of active position signal to indicate the valve is in full close or full open position.

Wiring Instructions:

1. Connect terminal 1 with null line.
2. When terminal 2 connects with phase line. it indicates "Opening" is in operation.
3. When terminal 3 connects with phase line. it indicates "Closing" is in operation.
4. When "Opening finishes its operation. the signal lamp connected with terminal 4 will be on.
5. When "Closing finishes its operation, the signal lamp connected with terminal 5 will be on.



S: Passive Contact Type

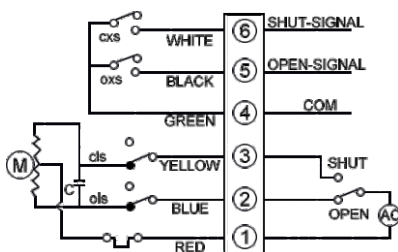

Valve can be controlled to open and close by the on-off circuit and the circuit will output a group of passive position signal to indicate the valve is in full close or full open position.

Wiring Instructions:

1. Connect terminal 1 with null line.
2. When terminal 2 connects with phase line. it indicates "Opening" is in operation.
3. When terminal 3 connects with phase line, it indicates "Closing" is in operation.
4. Terminal 4 is the passive contact common port.
5. When "Opening finishes its operation, terminal 5 will output Fully open Signal.
6. When "Closing finishes its operation, terminal 5 will output Fully close Signal.

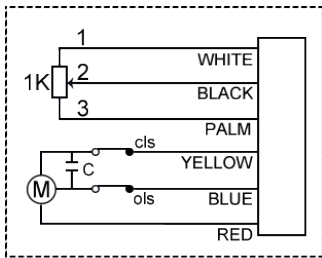


K: With Position Generator Type

Valve can be controlled to open and close by the on-off circuit and the circuit will output current signal corresponding to the openness angle of valve.

Wiring Instructions:

- 1 "N" is null line and "L" is phase line.
- 2 When "L" is connected with "On"; valve is in open operation.
- 3 When "L" is connected with "Off"; valve is in close operation.
- 4 Connect "+" of output terminal with the positive pole of output signal and "-" with negative pole of output signal.


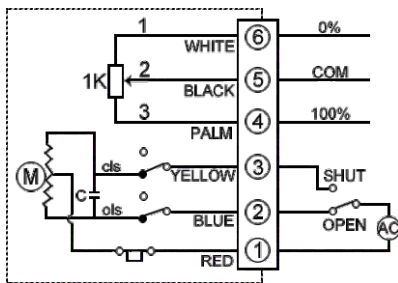


R: Opening Signal Type

Valve can be controlled to open and close by the on-off circuit and the circuit will output resistant signal corresponding to the openness angle of valve.

Wiring Instructions:

- 1 Terminal 1 connect with null line. Terminal 5 is the lift arm of potentiometer.
- 2 When terminal 2 connects with phase line, valve will open; when terminal 3 connects with phase line, valve will close.
- 3 Terminal 4 is the low side of potentiometer. When valve opens, the resistance between terminal 4 and 5 will increase with the opening degree.
- 4 Terminal 6 is the high side of potentiometer. When valve opens, the resistance between terminal 4 and 5 will increase with the closing degree.



A: Modulating Type


The opening or closing is realized by the standard signal through external computer or industry meter. Meanwhile, the corresponding standard signals will be output.

Wiring Instructions:

- 1 Connect "N" of input terminal with null line and "L" with phase line.
- 2 Connect the "+" of external control terminal with positive pole of Input signal, "-" with negative pole of input signal.
- 3 Connect the "+" of feedback terminal with positive pole of input signal, "-" with negative pole of input signal.

D: Direct Current On-Off Type

Opening or closing operation of valve can be realized by switching the positive and negative pole of external direct current. Meanwhile, a group of passive contact signal will be output to indicate fully openness or close of valve.

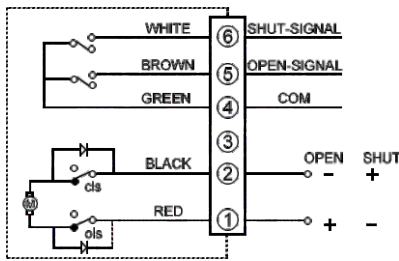


Wiring Instructions:

1. Valve will open when terminal 1 is connected with positive pole and terminal 2 with negative pole.
2. Valve will close when terminal 1 is connected with negative pole and terminal 2 with positive pole.
3. Terminal 4 is the passive contact common end.
4. When "Opening finishes its operation, terminal 5 will output Fully Open Signal.
5. When "Closing finishes its operation, terminal 6 will output Fully Close Signal

H: Three-Phase On-Off Type

Valve can be controlled to open and close by the on-off circuit and the circuit will output a group of active position signal to indicate the valve is in full close or full open position.

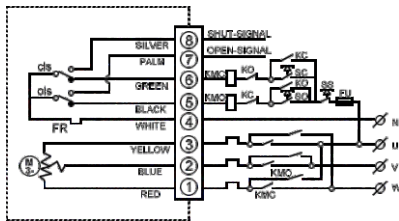


Wiring Instructions:

1. Connect terminal 1, 2, 3 with 3-phase alternate current. The motor will be operated to rotate close wise and anticlockwise through external phase inverter circuit.
2. Terminal 4 is the common port of external control circuit.
3. Terminal 5 is "open" operation control.
4. Terminal 6 is "close" operation control
5. When "Opening finishes its operation, terminal 7 will output Fully Open Signal.
6. When "Closing finishes its operation, terminal 8 will output Fully Close Signal.

T: Three-Phase Passive Contact Type

Valve can be controlled to open and close by the on-off circuit and the circuit will output a group of active position signal to indicate the valve is in full close or full open position.

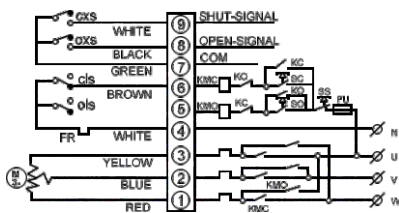

Wiring Instructions:

1. Terminal 1, 2, 3 connected with 3-phase power. By means of the external phase reversing circuit, running normally or reversibly of motor.
2. Terminal 4 is the common port of external control circuit.
3. Terminals 5 is "open" operation control.
4. Terminals 6 is "close" operation control.
5. Terminal 7 is passive contact common port.
6. When "Opening finishes its operation, terminal 8 will output Fully Open Signal.
7. When "Closing finishes its operation, terminal 9 will output Fully Close Signal.

Power, Voltage and Installation

Please choose power voltage according to product nameplate or wiring diagram.

Available voltages are listed as followings: AC380V±10%50/60HZ AC220V±10%50/60HZ DC24V

***Notes:** When choosing AC380V, pay attention to the sequence of phase line during wiring and make sure travel switch can correctly control openness and close of valve. Otherwise, the actuator would be damaged.

Selection of Fuse and Circuit Breaker

- In order to protect the actuator, avoid short circuit and reduce injuries, A circuit breaker can be connected at the power input terminal of each actuator.
- Choose the appropriate fuse protection based on the following table.

Model	Voltage	AC380V	AC220V	AC110V	AC24V	DC24V
	Fuse					
05		2A	2A	3A	5A	5A
10		2A	3A	5A	7A	7A
20/40/60		3A/5A	5A/7A	7A/10A	10A/11A	15A
100/200		5A	7A	10A	20A	/

Power lines of two or several electric devices can't be connected in parallel.
 Several electric devices can't be controlled by the same connection point.
 Otherwise, you will lose control or the motor will be overheating.

Installation

Cautions for Indoor Installation


- Products can't be installed in the room with explosive air unless they are of anti-explosive.
- Please install a shield to cover the product for safety if the product is installed in a place with water or raw material.
- Space is needed for inlet wiring or manual operation.

Adjustment of On-Off Type

...


Adjustment of Limit Position Switch (Drawing 2)

- ◆ Close the valve to fully closed position.
- ◆ Loosen the fastening screw of stroke blocker, turn the blocker below to activate the stroke switch. "Click" sound will be heard when the switch moves. Then fasten the screw. Adjustment way of full open position is the same as above.

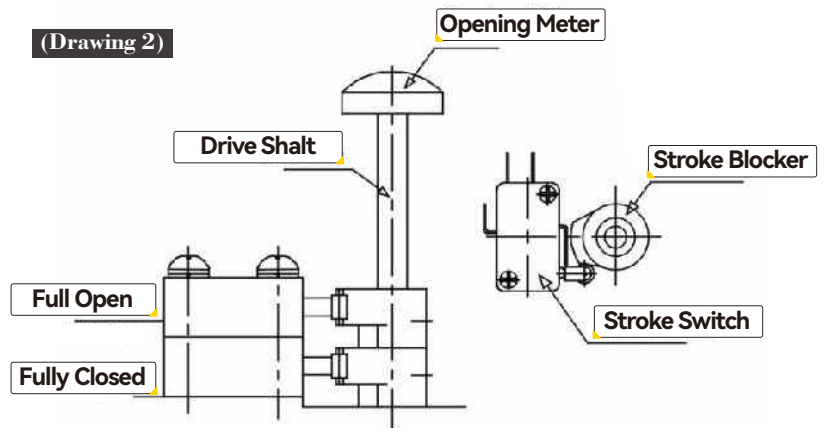

Adjustment of Middle Position Switch (Drawing 3)


- ◆ Operate the valve manually to desired position.
- ◆ Loosen the fastening screw of stroke blocker, turn the blocker below to activate the stroke switch. "Click" sound will be heard when the switch moves. Then fasten the screw. Adjustment way of full open position is the same as above.
- ◆ Motion position of two middle position switch can be adjusted in accordance with requirement.

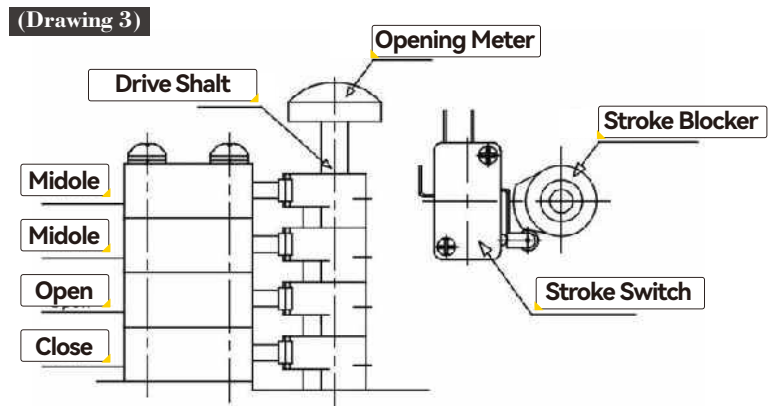


Regulation of Mechanical Position-limiting (Drawing 4)

- ◆ Rotate the handle to fully open position.
- ◆ Loosen tightening nut and rotate to adjust screw in order to make it contact the mechanical blocker. Then, rotate screw semi-circle and fasten the nut. In anticlockwise direction for tightening nut.
- ◆ Using same method, operator could regulate mechanical link-stopper at wholly-closed position.

(Drawing 4)

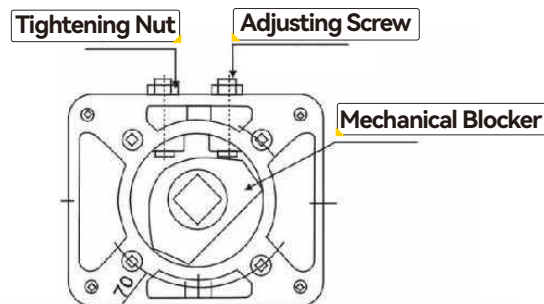

***Notes:** Mechanical position limit must lag behind the electric position limit. Or the motor will be too hot.

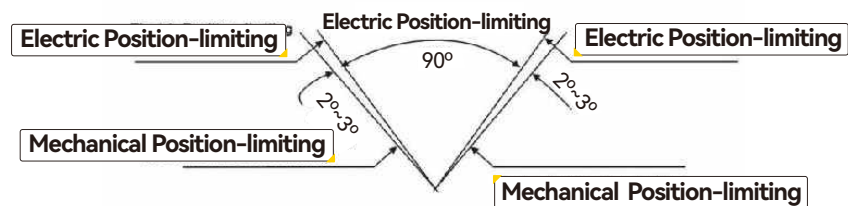


Potentiometer Adjustment (Opening Type R, Modulating Type A)(Drawing 5)

- ◆ The resistance value of potentiometer is 1KΩ.5KΩ;
- ◆ Rotate valve to fully closed position with handle;
- ◆ Loosen screw of opening-gear and rotate opening gear for regulating potentiometer.

Measure resistance value between 4 and 5 wiring terminals by universal meter, and make the resistance value achieve 10Ω, tighten opening gear, fixing screw. (If it is modulating type, resistance between RV and RS jacks shall be measured when connecting the seven-line connector).

(Drawing 5)

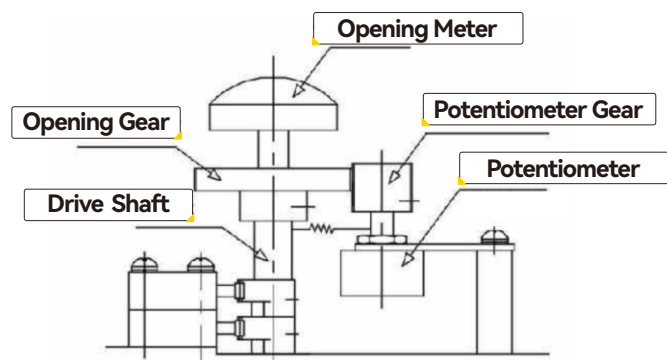



***Notes:** Potentiometer can be loosened for adjustment.

When fixing, pay attention to the mesh between potentiometer gear and opening gear, which can't be too large or small, or else, it would directly affect the precision of actuator.

Adjustment of Modulating Type

Actuator Adjustment

Before adjustment, you should understand the adjustment method of open and close angle. Adjust electric position-limiting, potentiometer and mechanical position-limiting of actuator in accordance with the fully openness and close of valve.

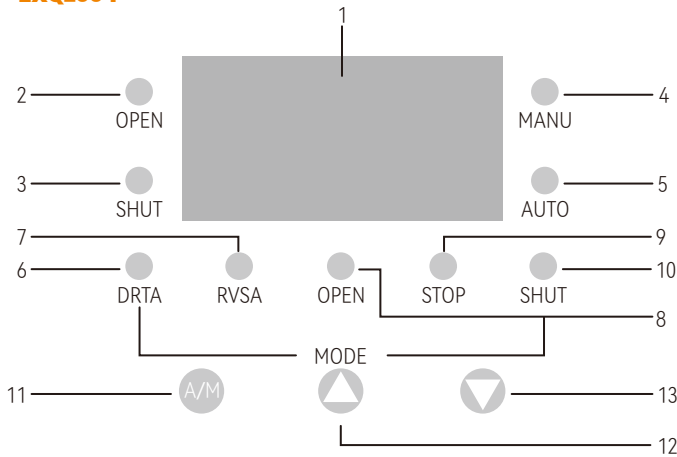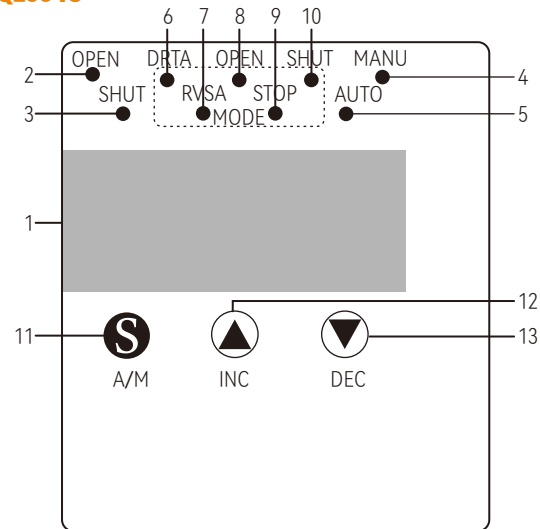ZXQ2004

ZXQ2004C


Positioner Panel



Data Display	1	LED Window	Actual opening value, setting opening value, temperature inside positioner and setting parameter can be indicated by switching the buttons.
Status Indication	2	OPEN	Output control "open", relay will shut
	3	SHUT	Output control "close", relay will shut
	4	MANU	Manual Status
Mode Indication	5	AUTO	Automation Status
	6	DRTA	Obverse-action mode, corresponding output of input signal is stated as following; 4mA-full(Normally set as fully open); 20mA-zero(Normally set as fully closed)
	7	RVSA	Reverse-action mode, corresponding output of input signal is stated as following; 4mA-zero(Normally set as fully closed); 20mA-full (Normally set as fully open)
	8	OPEN	Input signal suspension indicates "open", actuator opens to the largest position limit.
Button	9	STOP	Input signal suspension indicates "stop", actuator remains in the current position.
	10	SHUT	Input signal suspension indicates "closed", actuator closes to the largest position limit.
	11	A/M	Manual/Automatic switching button, button for parameter input, modification and switch
Button	12	▲	Value Increasing Button. It can be used to switch and indicate the set openness value in automatic status. It shows "open" in manual status.
	13	▼	Value Decreasing Button. It can be used to switch and indicate the inside temperature of positioner in automatic status. It shows "closed" in manual status.

Wiring Introduction

ZXQ2004 intelligent positioner can be connected with electric actuator through one seven-line connector:

There is a group wiring tightened by six-line spring pressure on positioner (as shown in drawing 6), of which the N, L lines is connected with mid-line and phase-line of 220VAC single-phase circuit, two 4~20mA (or 1~5V) IN terminals is connected with control current (voltage), two 4~20mA terminals are to give feedback of current signal output, which can be connected with ammeter so as to display actual opening value of valve. it also can be not connected.


Φ1~2mm single-core or multi-core infrared insulated line (shown in diagram 7) can be adopted as connection line. It is suggested to fasten tightly and plate tin onto multi-core line if this line is adopted. It is suggested to insert single-core line or tin-plated multi-core line into the hole if there is spring resistance, insert another 4-5 mm. If the wire is soft, insert the wire into the hole and press the spring locking switch with straight screwdriver, insert another 4-5mm and loosen the switch, then the wire is locked. The wire can't be pulled out under normal circumstance. If it's needed to pull out the wire, press the switch beside the corresponding hole with screwdriver and then pull out the wire.

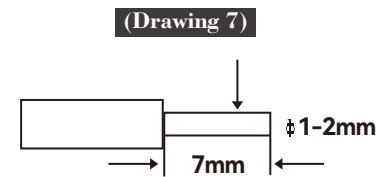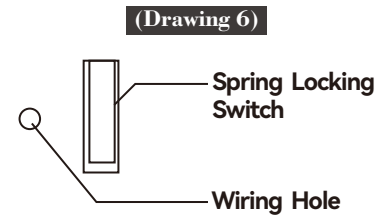

Setting Operation Intelligent Positioner

Connect the lines between given signal source, output signal measure meter (Disconnection is also allowed) and power supply according to wiring drawing.

- When the power is on, the actual opening value of valve would be displayed, and the positioner is under auto test status at this time.
- Press A/M button to switch to manual state, press ▲ and ▼ buttons separately to manually control the "open" and "close" of actuator.
- Under automatic status, press ▲ to check the set openness value of valve and the varying trend stability of input signal.
- Under automatic status, press ? to observe the inside temperature of positioner. When it exceeds 70 centigrade, the positioner will cease the open and close control of actuator;
- Under automatic status, press A/M button for 4S to enter the setting parameter shown in the table below, the parameter value could be revised by pressing ▲ and ▼ . see the operation progress diagram for details.

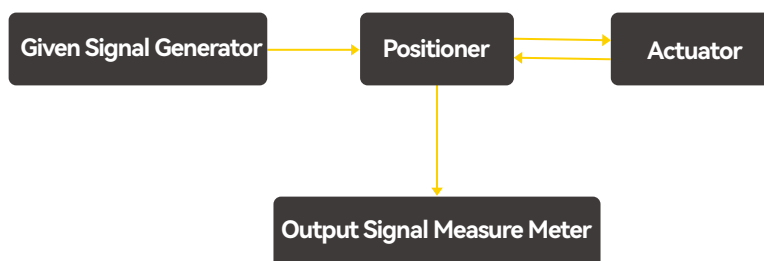

Parameter List

Parameter	Indicated Value	Meaning	Set Value
U0	00x.0	X=1 Electronic braking is allowed, X=0 Electronic braking is not allowed	1
	000.x	X=0 Positioning accuracy is not allowed but time readjustment is allowed. X=1,2,3 Time readjustment is not allowed but positioning accuracy is allowed	0
U1	00x.0	Set positive and active action. X=0 is positive, x=1 is negative.	1
	000.x	Signal Suspension Mode, x=0(neglection)x=1(open)x=2(stop)x=3(shut)	2
U2	xxx.x	Control output lower limit value is $0 \leq U2 < 100$, manual zero and full setting will not be limited by the parameter	0. 0
U3	xxx.x	Control output upper limit value is $0 \leq U2 < 100$, manual zero and full setting will not be limited by the parameter	100. 0
U4	00x.x	The precision is adjustable, it equals $x.x/100$	0. 4
U7	xxx.x	Operation password, (U5=003.1 is opening setting of entering the actuator	/
U5	xxx.x	Actuator zero position confirmation, press ▲ and ?button. When it reaches full position, press A/M button for zero position confirmation, then enter U7.	/
U6	xxx.x	Actuator zero confirmation. Press ▲ and ?button. When it reaches full position, press A/M button for full position confirmation.	/

Notes: Other parameters are reserved by manufacturer, Appendix will be taken for reference if needed.

The parameters of actuator have been set before delivery. It can be applied by directly connecting power supply, signal source and output signal measure meter (Disconnection is also allowed) without any resetting.

If it's needed to set, the following procedure could be followed.

Set the zero and full position of actuator. This setting will exert no effect on input, outputting signal of positioner. After the resetting, rotary angle shall be reset, then the actuator could work normally. The setting falls into the following two methods:

Method 1(Manual Setting)

(According to the operating process):

- Enter into U5 and modify U5= 003. 1, then press A/M button again and enter into U6 parameter (set zero position). Press ▲ and ▼ button, the actuator will operate towards "open"and "close" direction accordingly. The actual opening value of valve displayed will increase and decrease accordingly. When expected zero position (usually set at full close position) is reached, press A/M button for zero position confirmation and enter into U7 parameter.
- Enter into U7 parameter (set full position), Press ▲ and ▼ button to expected full-position (normally y at full open position), and press A/M button for full position conformation. The actuator will be back to 90% position automatically and return to U5, then return to U5.
- Revise U5=000.5 to return to test control status.


Method 2(Automatic Setting)

- Enter into U5 and revise U5 to be 003. 1, then press A/M button and ▼ button and then release them at the same time. Automatic setting will be started. The zero position will first be set in positioner and then the full position. The positioner will be in manual status after setting. ★Re-enter parameter U5 and modify U5=000.5 (default value)and then press A/M button, the set result Will be saved.

During test control process of positioner, the actuator will vibrate and be heated because of input signal quality, externalelectromagnetism disturbance. To avoid the vibration, the U0 (000.X)can be modified: 1. Set x=0, the position precision will remain the set precision during the vibration of actuator, the readjustment time of actuator will increase to 7 s to meet the requirement of precise positioning and interval operation of actuator; 2. X=1,2,3, the readjustment time will remain unchanged (about 2s)during vibration of actuator. The precision of actuator will decrease so as to work under the most appropriate precision.

If there is 10s interval during parameter modification, test control status will be restored.

Operation Process

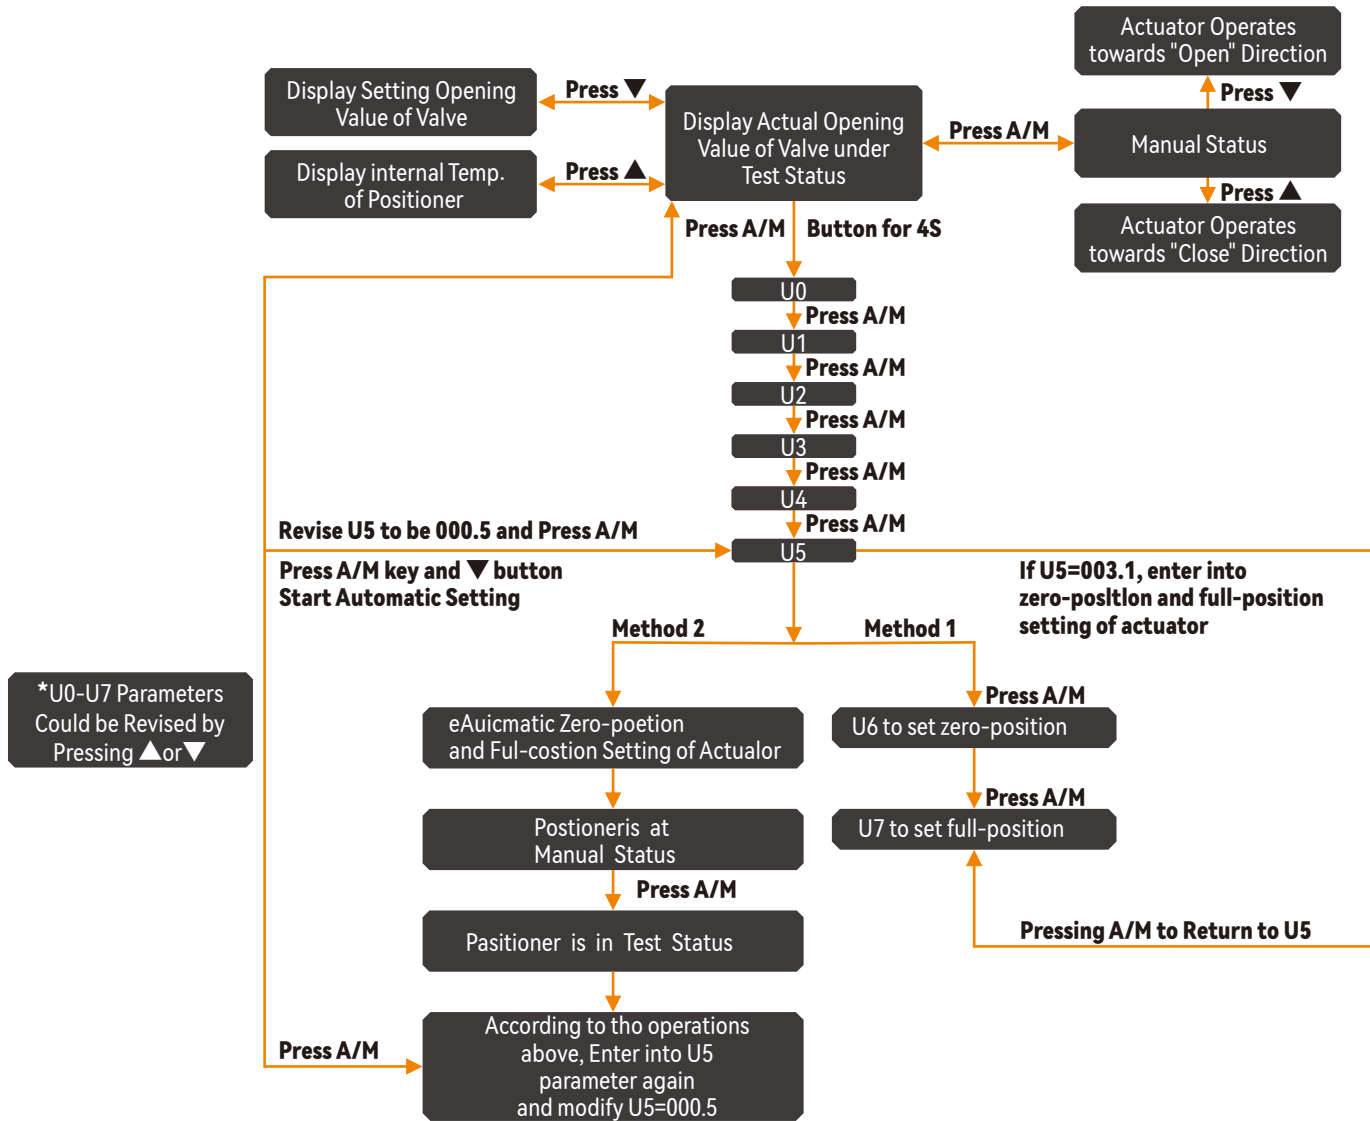

Setting Operation of Intelligent Positioner

Error Code List

Error Code	Meanings
E-01	Controlling Signal Suspension or below 0.3mA
E-03	Signal Feedback line or open-close line between positioner and actuator are connected wrangly
E-05	Actuator vibrates heavily, maybe because of the instability of input signal or feedback signal, high precision, etc.
E-06	Actuator is blocked during operating towards close direction.
E-07	Actuator is blocked during operating towards open direction.
E-08	Inside temperature of positioner exceeds 70°C

Cautions for Outdoor Installation

- Please install a shield to cover the product to avoid rain or direct sunlight;
- Space is needed for inlet wiring or manual operation.

***Notes:** The sunlight outdoor would lead to high-temperature which can accelerate aging of components and even losing effectiveness;
The rain would accelerate aging of rubber-pad. Moreover, failure to avoid rain will lead to damage to product.

Ambient Temperature and Fluid Temperature Condition

- Ambient temperature shall be between -30°C and $+60^{\circ}\text{C}$.

***Notes:** Actuator with damp heater shall be chosen when it is applied in place with temperature below zero centigrade or with large temperature gap.


- High-temperature connector shall be used to mount the actuator on valve if the fluid temperature is high.

Wirng Cable and Wiring

- $\varnothing 8$ cable shall be applied for 05 PG11 wire-in line lock.
- $\varnothing 8$ cable shall be applied for 10 PG11 wire-in line lock.
- $\varnothing 8$ cable shall be applied for 20/40/60/100/200 PG11 wire-in line lock.
- $\varnothing 8$ cable can be applied according to dimension of wire-in line lock so as to guarantee safety and reliability of wiring;
- Pass the cable through line-lock and fasten line end onto terminal stand;
- Tighten cover of wire-lock for fastening the cable.

Wiring Line Pipe

- When using line-pipe, it must be waterproof;
- As shown in drawing 1, the actuator shall be higher than line pipe to prevent actuator damage resulted from water drop flowing into the actuator by walking along the wire.

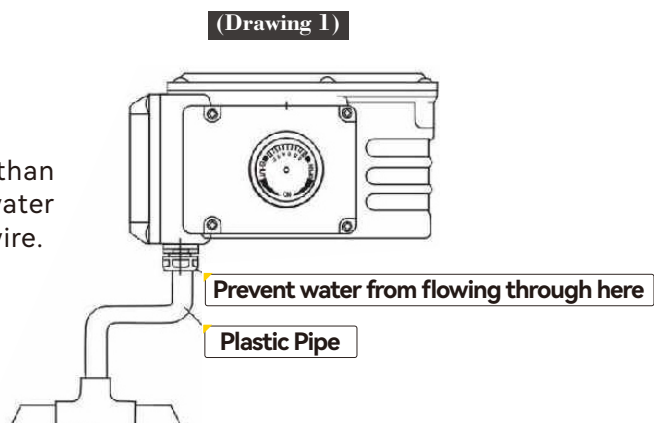


Model Selection

Model	Output	Motion Time (0~90°)	Power Supply	Hard-Sealing Butterfly Valve	Soft-Sealing Butterfly Valve	Ball Valve	Ventilating Butterfly Valve
				/	≤Pn1.6MPa	≤Pn1.6MPa	≤PN1.0MPa
02	6N.M	7S	Ac110, AC220V 50/60HZ. DC24V	/	DN25	≤DN20	/
05	15N.M	10S	AC110V, AC220V, AC380V, 50/60HZ; DC24V	/	≤DN65	≤DN40	DN50~DN80
	30N.M	20S					
	50N.M	30S					
10	50N.M	13S		DN40~DN65	DN80~DN125	DN40~DN50	DN100~DN200
		15S					
	60N.M	20S					
	100N.M	30S					
20	80N.M	9S		DN80~DN125	DN150~DN200	DN65~DN80	DN250~DN300
	100N.M	15S					
	150N.M	20S					
	200N.M	30S					
60S							
40/60	150N.M	9S		DN150~DN200	DN250	DN100~DN125	DN350~DN500
	250N.M	15S					
	400N.M	20S					
		30S					
600N.M	60S						
	100	800N.M	30S	DN250	DN300~DN350	DN150~DN200	DN600~DN800
1000N.M		50S					
200	2000N.M	100S	DN300~DN400	DN400~DN500	DN250~DN300	DN800~DN1000	
400	4000N.M	100S	DN400~DN500	DN500~DN600	DN300~DN400	DN1000~DN1200	
600	6000N.M	150S	DN500~DN600	DN800~DN600	DN400~DN500	DN1400~DN1600	

Actual torque of valves vary a lot because of different manufacturer and different application even for valves of the same dimension and same model. It is therefore suggested to choose the actuator model by taking 60%-80% of rated output torque of actuator as the working torque of valve.

Appendix/Other setting --see the drawing below for input signal, output signal setting

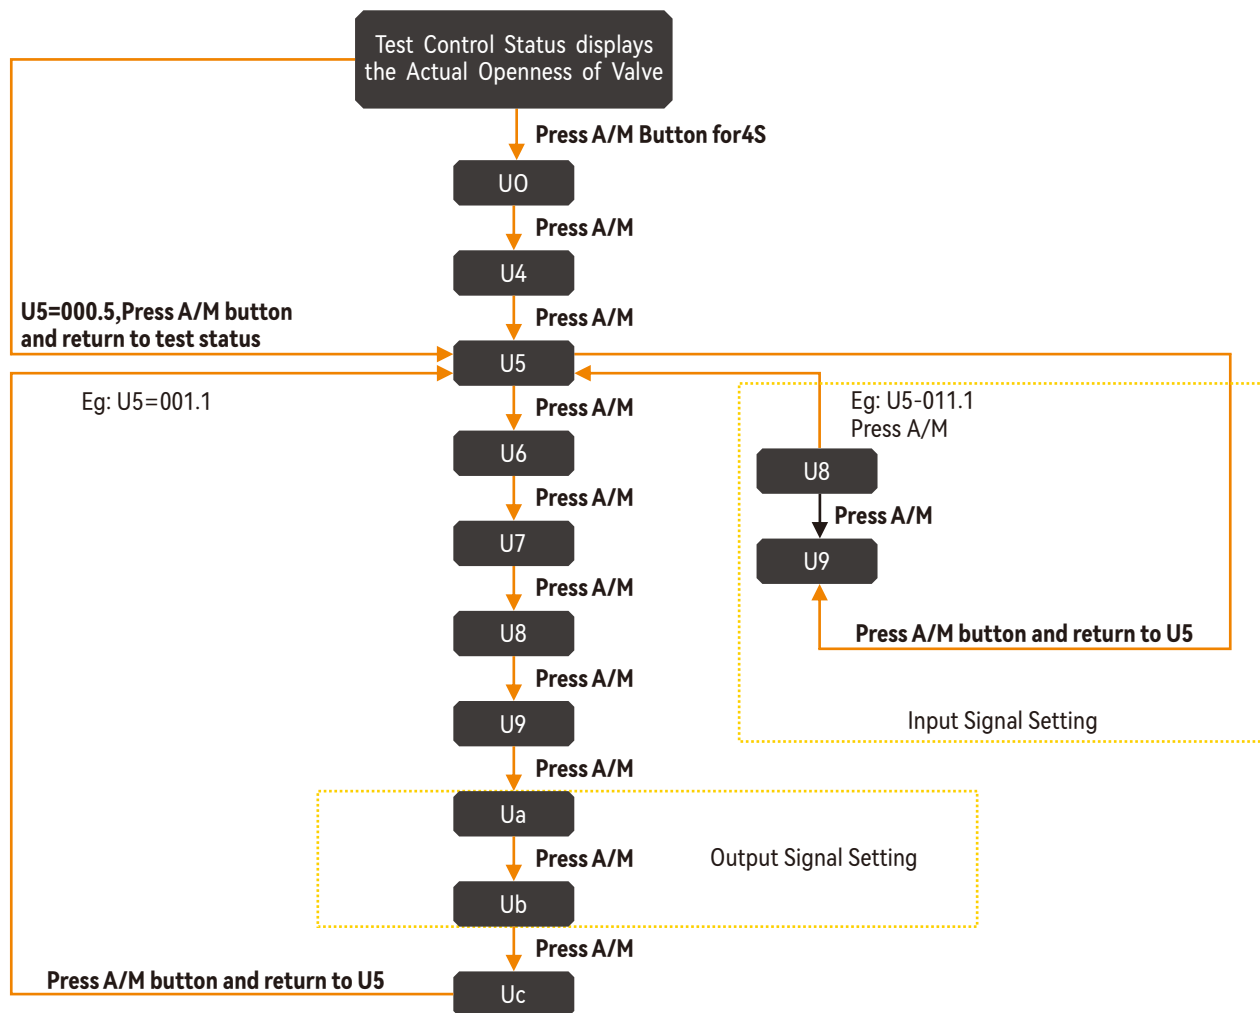

Updating Version Introduction of ZXQ2004 Model

1. A simplified automatic setting method is added. Press A/M button and ? button under automatic status and then release at the same time, the automatic setting will be activated (The function is the same as the auto matic setting in method 2)

2. According to the setting method in the instruction manual, set full position(U7), press confirmation button (A/M), it will not return to U5 immediately. However, the electric valve will go to 10% position of setting measurement, then return to U5.

3. Another function of anti-blocking is added to the module. When the electric valve is blocked 10% of the full range time), the module will stop controlling output. It will check the blocking again after one minute. If the malfunction does not solved, it will check the valve again three times in one minute. Fault code and valve position value will be shown alternately on the display screen. If the fault still exists, the module ceases checking and displays fault module, then stops working.

The module will be back to normal by pressing the panel button or charging with electricity.



(This operation is not required after delivery, please use it under engineer's instruction if needed.)

Input Signal Setting

- Under normal test status of positioner, press A/M button for 4s to enter into parameter setting status; the "U0" data value will be displayed. Select "U5" parameter by pressing A/M button, Press ▲ or ▼ button to modify value of "U5" to be 011.1. (See the No. Meaning in the following table for reference)
- Enter into "U8" parameter value to adjust zero position of input current; When setting, input the zero position through external instrument (4mA usually), then press A/M button for confirmation, Then enter into "U9" parameter.

Parameter	Display Value	Meanings
U5	0xx. x	Enter into password setting. U5=011.1, enter into input current; setting U5=001.1, enter into output current setting; U5=003.1, enter into zero, full position setting of actuator.
U6	xxx. x	Zero-Position Confirmation Parameter of Actuator
U7	xxx. x	Full-Position Confirmation Parameter of Actuator
U8	xxx. x	Zero-Position Parameter Adjustment of Input Current
U9	xxx. x	Full Range Parameter Adjustment of Input Current
Ua	xxx. x	Zero-Position Parameter Setting of Output Current
Ub	xxx. x	Full Range Parameter Setting of Output Current
Uc	xxx. x	Inside Temp. Adjustment

- "U9" parameter is the full-range adjustment of input current: During adjustment, input the full-range signal (usually 20mA) through external instrument, press A/M button for confirmation, then enter into "U5" parameter to modify U5=000.5, press A/M button for confirmation and exit. The setting will be finished.

Output Signal Setting

- Make sure the cleanness and stability of input signal during the operations above.
- Enter into U5 parameter, correct U5=001.1, press A/M button to enter U6 parameter.
- Skip parameter U5, U6, U8 to enter into Ua.
- "Ua" is the zero-position setting of output current: During setting, press ▲ and ▼ to set output 4mA or other value. The value will be corresponding to the zero-position output signal value of actuator, press A/M button to confirm and then enter into Ub parameter.
- "Ub" parameter output current range setting: Press ▲ and ▼ to set the output 20mA or other value. The value will be corresponding to the full-position output signal value of actuator, press A/M button to confirm and then enter into Uc parameter.
- "Uc" parameter is to modify the temperature inside the cover. Press ▲ and ▼ for adjustment.
- Press A/M button for confirmation. Then return to "U5" parameter. Modify "U5" value, make U5=000.5. Press A/M button to confirm and back to test status.

Failure and Countermeasure


Failure Status	Reason	Countermeasure
Motor doesn't rotate	The power supply and voltage is low, or no power supply	Check power and voltage
	Input signal suspends or the value is not enough	Check input signal
	Break line is separated from terminal stand	Connect wire and replace terminal stand
	Temperature protector works	Lower the ambient temperature
		Reduce use frequency
		Load is too heavy
	Limit switch actions at the middle openness	Adjust stroke blocker
	Capacity used for motor enter-phase is damaged	Replace the capacity
Motor is disconnected	Replace the motor	
Control box is damaged	Replace the control box	
The openness varies continuously	There is interruption signal in signal source	Check input signal
	The interruption is produced from potentiometer	Replace potentiometer
	The gear of potentiometer or opening are loosened	Check screw of tightening gear
The input signal doesn't conform with opening	Input signal is wrong	Check input signal
	Adjustment of zeroing, multiplying-power has problem	Readjust multiplying-power to zero position
	Position of potentiometer gear is changed	Readjust the potentiometer gear
No opening signal	Opening signal line is disconnected or connection has problem	Check wiring

QT Quarerr-turn Valve Electric Actuators

The QT range, a updated product of our company is a quarter-turn electric actuator which has absorbed foreign advanced technology. It can operate with butterfly valve, ball valve and cock valve and other kinds of quarter-turn valves. Its case body is made of die-casting aluminum, compact and light, which boasts of a striking design.

QT range is featured by high efficiency, high reliability, high protection class and low noise. Both remote control and local control are available. This product has been applied to many fields, such as petroleum, chemicals, electricity, water treatment and paper-making industry.

The protection class is IP67 rated for basic and integral types.

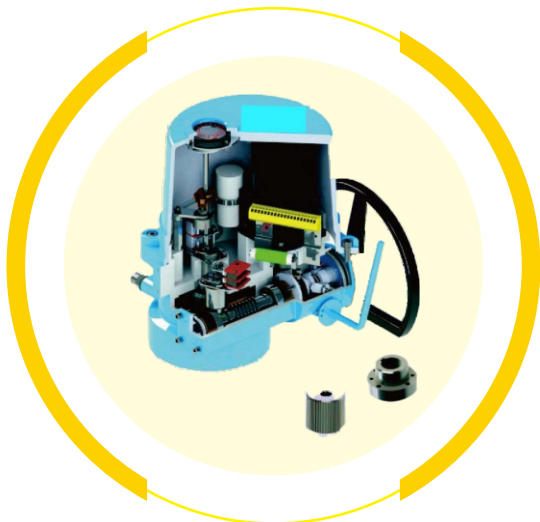

Working environment and main technical parameters

1. Power supply:

conventional three-phase 380V (50Hz)
single-phase 220V (50Hz)
special three-phase 415V (50Hz, 60Hz)
440V (50Hz, 60Hz)

2. Ambient temperature

-20°C~+60°C

3. Ambient relative humidity:

no more than 90% (25°C)

4. Altitude

no more than kilometers

5. Protection level

IP67

6. Work system

short-time work system, rated time is 10 minutes

7. Working condition requirements

no strong vibration

Specifications and main performance parameters

Table 1

Modol	Specfction	Output Torqa (N.m)	Output Speed (r/min)	Maximum Stem Diameter (mm)	Motor Powor (Kw)	Running Time (s)	Reference Weight (kg)
QT1	QT05	50	1	22	0.025	15	10
	QT08	80					
QT2	QT10	100	1/2	32	0.025	15/8	13
	QT15	150			0.04/0.06		
	QT20	200			0.06		
QT3	QT30	300	0.5/1	32	0.06	30/15	18
	QT40	400			0.09		
QT4	QT60	600	0.5/1	42	0.12	30/15	25
	QT80	800			0.18		
	QT100	1000					
QT4/JS	QT150	1500	0.37	50	0.18	50	50
	QT200	2000			0.2		
	QT250	2500					

Motor technical parameters

Table 2


Three 380v motor power (Kw)	0.025	0.04	0.06	0.09	0.12	0.18	0.2
Rated current (A)	0.26	0.57	0.65	0.72	0.85	1.3	2.1
Stall current (A)	0.52	0.85	1	1.5	1.8	2.2	3.4

Table 3

Single 220v motor power (Kw)	0.025	0.04	0.06	0.09	0.18	0.2
Rated current (A)	0.57	0.72	0.95	1.8	2.2	2.4
Stall current (A)	0.75	1.05	1.75	3	3.5	3.8

Appearance and connection size

Figure 1

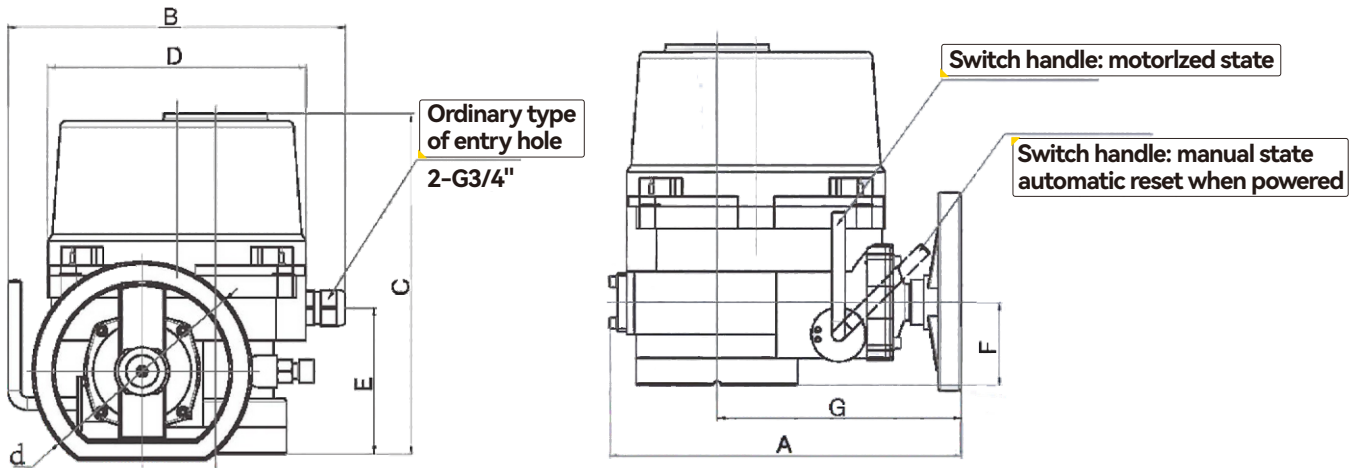


Basic form factor

Table 4

Modol	QT1	QT2	QT3	QT4	QT4/JS
A	232	274	302	333	357
B	221	268	391	313	325
C	233	271	325	342	451
D	157	206	222	258	258
E	104	116	119	127	236
F	55	67	70	78	187
G	167	197	208	227	227
d	100	170	200	250	250

Intelligent integrate size

Figure 2

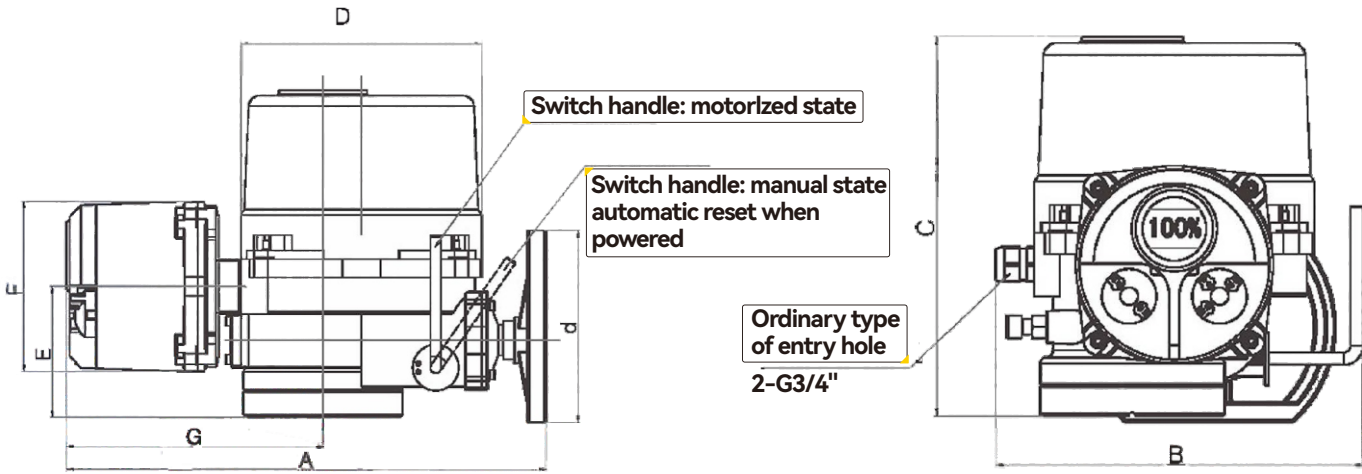

Intelligent integrate


Table 5

Modol	QT1	QT2	QT3	QT4	QT4/JS
A	378	420	447	478	478
B	221	268	391	313	325
C	223	271	325	342	451
D	157	206	222	258	258
E	104	116	119	127	236
F	155	155	155	155	155
G	208	229	234	251	251
d	100	170	200	250	250

Electrical installation and valve connection

The connection flange with the valve meets the requirements of ISO5211, which ensures that the electrical installation and the valve are properly connected through the stem connector. Specific connection parameters are shown in Figure 3 and Table 6.

Figure 3

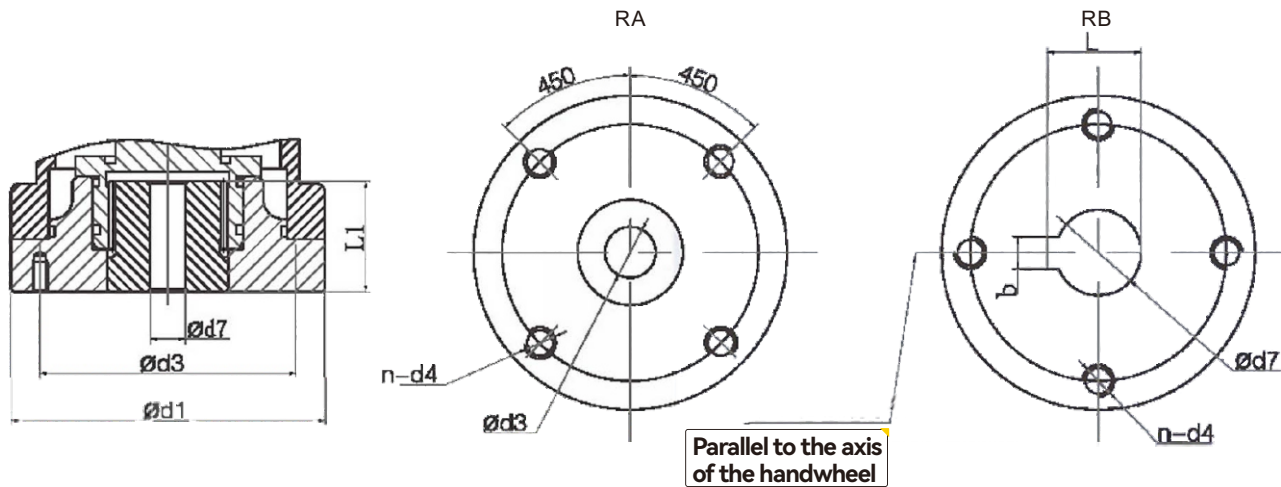

Contiguous dimensional drawing

Table 6

Model	Flange		Φd1	Φd3	Φd7			b	L	L1	Φd4
					Standard size	Reserved size	Maximum allowable				
QT1	RA	F05	102	50	/	10	22	/	/	45	4-M6深12
		F07		70	/			/	4-M8深12		
	RB	2"2.5"3"		57.15	12.6	/	/	3	14		4-M6深10
QT2	RA	F05	125	50	/	10	22	/	/	45	4-M6深12
		F07		70	/			/	4-M8深12		
		F10		102	/	15	32	/	/		4-M10深15
	RB	2"2.5"3"		57.15	12.6	/	/	3	14		4-M6深10
		4"		69.85	15.77	/	/	5	18.07		4-M10深15
		5"6"			18.92	/	/	5	21.22		
QT3	RA	F10	150	102	/	15	32	/	/	45	4-M10深15
	RB	8"		88.9	22.1			/	/		5
QT4	RA	F12	175	125	/	20	42	/	/	58	4-M12深18
		F14		140	/			/	4-M16深25		
	RB	8"		88.9	22.1	/	/	5	24.4		4-M12深20
		10"			28.45	/	/	8	31.75		
		12"14"		107.95	31.6	/	/	8	34.9		
QT4/JS	RA	F14	215	140	/	20	50	/	/	77	4-M16深25
		F16		165	/			/	4-M20深30		
	RB	16"		158.75	33.15	/	/	/	36.45		4-M18深30
		18"			38	/	/	10	41.3		
		20"			41.15	/	/		44.45		